

JOHNSON CITY POWER BOARD


CONCRETE ENCASED ELECTRODE REQUIREMENTS



NOTES:

CONTACT ELECTRICAL INSPECTOR
BEFORE FOUNDATION IS FORMED

ELECTRICAL ROUGH-IN INSPECTION MUST BE
PURCHASED

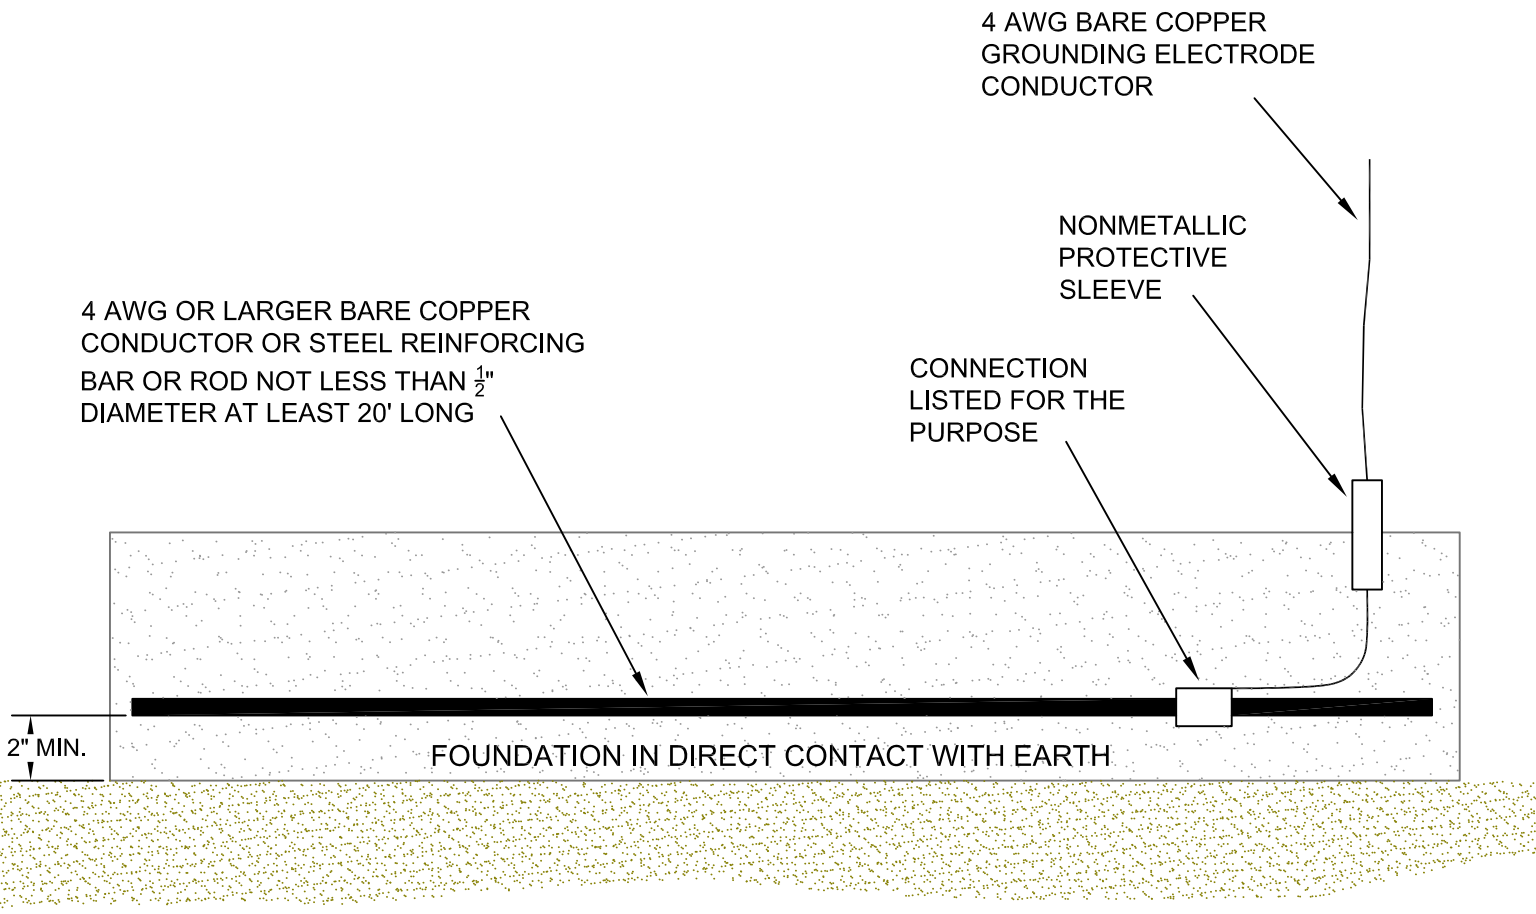

DRAWING NOT
TO SCALE